

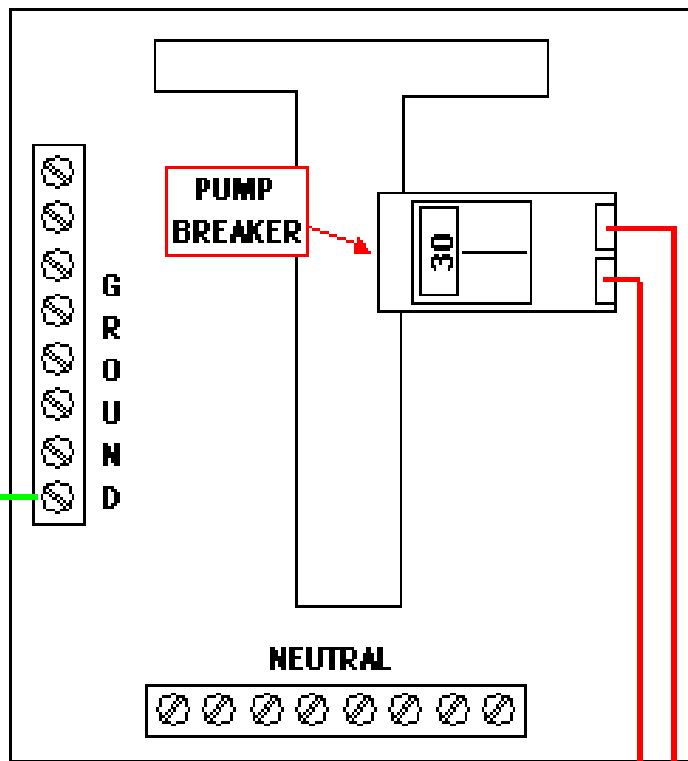


SUB-PANEL

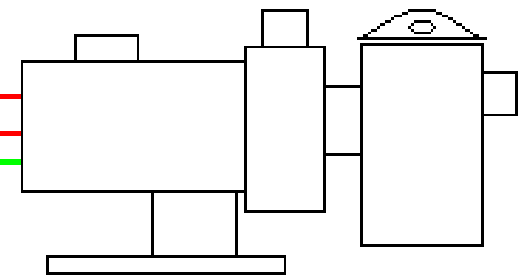

TIMER



1- IN A "STOCK" JET PUMP CIRCUIT, THE TIMER CONTROLS THE PUMP BY INTERRUPTING ONE LEG OF THE PUMP POWER. TURNING THE TIMER ON COMPLETES THE CIRCUIT AND POWERS THE PUMP. WHEN THE TIME CYCLE IS COMPLETE, THE TIMER OPENS THE CIRCUIT AND INTERRUPTS THE POWER TO THE PUMP, AND THE PUMP STOPS.

****THIS CIRCUIT WILL NOT WORK WITH AN SR500****